



## Operating Reserves, Version 10

Effective: 10/1/2014

Pursuant to its Tariff, BPA makes **Operating Reserves**<sup>1</sup> available to Customers to meet the **Customer**<sup>2</sup>'s Operating Reserve Requirement. This Business Practice describes the criteria the Customers must meet to fulfill both the Operating Reserves Requirement and to be a self or third party supplier.

Version 10 incorporates the changes required to be consistent with the FERC approved WECC Standard BAL-002-WECC-2.

### A. General Criteria

1. A Customer may purchase Operating Reserves to cover its Operating Reserve Requirement from BPA Transmission Services pursuant to its Tariff. Note: Operating Reserves are referred to as contingency reserve in WECC and NERC documents.
2. Operating Reserves applies to either Ancillary Services or Control Area Services whereby the Customers with load or generation located within BPA's metered Control Area that have a reserve requirement determined in accordance with applicable WECC and NERC standards are required to obtain such service.
3. BPA Transmission Services is obligated by the Western Electric Coordinating Council's (WECC) standard for contingency reserves to carry reserves for contingencies within its Control Area boundaries.
4. Generators operating in the BPA Control Area that provide power through an interconnected system without a BPA Transmission Services transmission agreement must obtain the Control Area Services of Operating Reserves Services and supply BPA Transmission Services with a **Generation Estimate**<sup>3</sup> schedule during the Pre-Schedule time window.
5. Real-time changes to the Generation Estimate schedule should be made during the Real-Time scheduling window. See BPA Transmission Services Scheduling Transmission Service Business Practice.

---

<sup>1</sup>(Also called Contingency Reserves) The combination of Operating Reserve-Spinning Reserve Service and Operating Reserve-Supplemental Reserve Service. Fifty percent of Operating Reserves Services must be Spinning Reserves Services.

<sup>2</sup>Any customer taking service under Use of Facilities (UFT), Formula Power Transmission (FPT), Integration of Resources (IR), Part II or Part III of the OATT.

<sup>3</sup>The scheduled hourly energy generation from a plant.

- 
6. Customers must make arrangements for the provision of Operating Reserves Services to support their transmission transactions. Generators pay for Control Area Services of Operating Reserves when the Operating Reserves Services are not otherwise provided.
  7. If the Customer chooses to Self-Supply or third-party supply its Operating Reserves Services, the resource(s) supplying such services must respond to automated signals sent from BPA's Control Area calling upon the resource(s), and an observable response must occur.
  8. A **Third Party Supplier**<sup>1</sup> may provide Operating Reserves Services to more than one Customer. Such supplier must provide the aggregate total requirement of all its Customers for every hour of the year.
  9. Plant operators with generation operating in the BPAT Control Area must notify BPA Transmission Services' generation dispatcher (dispatcher) of any contingency due to equipment problems that results in partial or total reduction of the generator's scheduled energy delivery for the hour, within four minutes of the occurrence of the contingency event. The notification provisions coincide with the Northwest Power Pool (NWPP) Reserve Sharing Procedures (RSP).
    - a. The plant operator shall provide the following minimum information to the dispatcher:
      - i. The name of the plant
      - ii. What resources(s) suffering a contingency, unit number or name
      - iii. The time of the contingency
      - iv. The reason for the contingency
      - v. The amount of reserves required (in MW) reflecting the actual amount of generation lost. See Appendix B below to determine the amount of generation lost
      - vi. How long the reserves are required (up to the remainder of the **Scheduling Hour**<sup>2</sup>)
      - vii. Other information as may be requested by the dispatcher
  10. Prior approval for alternative methods of notification, other than by plant operators, may be granted by the dispatcher only after a site visit.

---

<sup>1</sup>A resource operator who agrees to supply to Transmission Services a customer's total Operating Reserve Requirement for all of that customer's agreements with Transmission Services.

<sup>2</sup>Settlement covers reserve energy delivery for the remainder of the current hour and including the next hour if the event occurs after 30 minutes into the current hour.

11. If a dispatcher is unable to perform its reliability duties for an approved alternative, BPA Transmission Services may revoke the method of notification.
12. If a plant operator does not report a contingency within the specified time, the dispatcher may deliver the contingency energy at its discretion. Generation Imbalance or **Energy Imbalance**<sup>1</sup> charges may apply.

## B. Spinning and Supplemental Services

1. A Customer's Operating Reserve Requirement for Spinning and Supplemental Services for all of its agreements with BPA Transmission Services must be supplied by one of the following alternatives:
  - a. Purchase from BPA Transmission Services
  - b. Self-Supply
  - c. Third Party Supply
2. A Customer must have the same **Supplier**<sup>2</sup> for all agreements with BPA Transmission Services. However, the Supplier does not have to necessarily use the same resource to supply the reserves for all agreements.
3. Selection of an Operating Reserves Supplier
  - a. At the time a Customer makes its initial request for transmission service with BPA Transmission Services, it must indicate its provider for Operating Reserves Services.
  - b. BPA Transmission Services is the default provider under any of the following conditions:
    - i. No election was made by the Customer
    - ii. The designated Supplier fails to perform to its obligation
    - iii. The supply arrangements the Customer has made are not comparable to purchasing Operating Reserve Services from the BPA Transmission Services
    - iv. The designated Supplier or BPA Transmission Services have not completed implementing and testing the necessary interfaces, systems, or software required in order to comply with this Business Practice by the start of the ensuing **FY**<sup>3</sup> (FY) (October through September).

---

<sup>1</sup>Difference occurring between hourly scheduled amount and hourly metered (actually-delivered) amount associated with transmission to a load located in BPA's Balancing Authority Area or from a generation resource located within BPA's Balancing Authority Area.

<sup>2</sup>Either the third party supplier or the self-provider.

<sup>3</sup>Fiscal Year - October - September

- c. For the two-year election period beginning at the start of the next Rate Period, a Customer desiring to change its Operating Reserve Service provider must make its two-year election in writing or by email to BPA Transmission Services no later than May 1 prior to the start of the next Rate Period, and stating whether the customer intends to: (i) obtain Operating Reserve Services from a Third Party; (ii) self-supply Operating Reserve Services; or (iii) cease self-supply or third party supply of Operating Reserve Services and designate BPA Transmission Services as the Operating Reserve Services provider.
  - i. If the Customer does not intend to change its Operating Reserve Service provider, no action is required.
  - ii. If the Customer chooses BPA Transmission Services as their Operating Reserve provider for two-year election period, the Customer may not change their Operating Reserve provider until the following two-year election period, when Customers will be able to select their Operating Reserve provider for the two-year period commencing at the beginning of the subsequent Rate Period.
  - iii. A Customer that self-supplies or third party supplies may change their non-BPA Transmission Services provider on an annual basis, but must make this election no later than May 1 prior to the start of each year during the Rate Period.
  - iv. If the Customer elects to change its Operating Reserve provider from BPA Transmission Services, BPA Transmission Services will notify the Customer no later than July 1 prior to the start of the next Rate Period, whether the proposed supply arrangements are comparable to purchasing Operating Reserve services from BPA Transmission Services.
  - v. For Customers that elect self-supply or third party supply of Operating Reserve Services, if the Customer elects to change its non-BPA Transmission Services provider in accordance with d.ii below, BPA Transmission Services will notify the Customer no later than September 1 of the FY in which they Customer's election is made whether the proposed supply arrangements are comparable to purchasing Operating Reserve Services from BPA Transmission Services.
  - vi. BPA Transmission Services will provide the Customer with an approximate date in which BPA Transmission Services will implement the Operating Reserves Services. See d below.
  - vii. If conditions change such that the Customer is no longer able to Self-Supply or Third-Party Supply Operating Reserves, or if a Supplier is no longer eligible pursuant to the Eligibility Criteria for Suppliers section below, BPA Transmission Services will notify the Customer that BPA Transmission Services will be the default provider for the time remaining in the election period.

- d. The Customer is responsible for the costs associated with the placement of the required communications and control equipment and systems.
  - i. If the provisions for Dynamic Schedules of the resource by BPA Transmission Services do not exist, the infrastructure may take more than a year to put in place.
  - ii. BPA Transmission Services must approve the Customer's provision plans to assure that North America Electric Reliability Council (NERC) and the WECC reliability requirements can be met when the plan is implemented.
4. The Customer may use a resource in another control area to supply Operating Reserves Services provided that the resource's deployment signal is automated and that BPA Transmission Services can observe a distinct measurable response.
5. The generator having the contingency is responsible for the costs associated with the energy delivered from Operating Reserves Services on behalf of resources inside of the BPA Control Area, consistent with the applicable [ACS Rate Schedule](#).
6. BPA Transmission Services will determine the amount of energy delivered when Operating Reserves Services is called upon using one of the following methods:
  - a. Using the MWh meter readings from the resource declaring the contingency as given to BPA Transmission Services at the end of the hour, or by direct telemetry, and subtracting that amount from the scheduled amount of energy delivery (Scheduled Generation used for Generation Imbalance Service) for the hour;
  - b. **Station Control Error**<sup>1</sup> (SCE) if the generation has a variable schedule and BPA Transmission Services determines the MWh contingency energy by continuously integrating the telemetered actual generation minus the variable schedule;
  - c. If the MWh meter reading is not available, BPA Transmission Services will calculate the energy delivered using the generation capacity lost each hour multiplied by the number of minutes remaining in the hour divided by 60;
  - d. The Operating Reserves energy delivery is the difference between the Scheduled Generation for the hour and the energy produced by the resource that had the contingency;
    - i. If the amount of energy supply produced is equal to or greater than the Scheduled Generation for the hour, no settlement of Operating Reserves energy is required;

---

<sup>1</sup>The difference between the amount of generation scheduled from a generator and the actual output of that generator.

- ii. If the energy supplied by the Supplier's resources in response to BPA Transmission Services' request is greater than the amount needed for the contingency, the resource declaring the contingency will be charged for this energy.
  - e. Settlement covers reserve energy delivery for the remainder of the current hour; and includes the next hour if the event occurs after 30 minutes into the current hour.
  - f. BPA Transmission Services will determine how much energy each Supplier delivered and the settlement obligation of the generator experiencing the contingency event.
  - g. The settlement will be a bill to the generator receiving reserve energy and a credit to each Supplier of reserve energy. Monetary settlement for the energy delivered will be based on the energy index price. One or more indices will be posted on the **OASIS**<sup>1</sup> specifying the season or month each index will be used.
  - h. The Energy Return Option will be suspended for the following reasons:
    - i. Applying the Operating Reserve Requirement to small schedules will result in numerous return obligations of less than one MW. Current practice does not allow scheduling energy of less than one MW.
    - ii. The methodology for determining the return obligation and notifying the generator of return hours and amounts is not available.
7. BPA Transmission Services follows the NWPP RSP for energy settlement of exchanges outside of BPA's Control Area. This document is available at the following web address: <http://www.nwpp.org/>.
8. The most recent NWPP RSP settles all transactions for reserve deliveries financially. BPA Transmission Services will use the market index described in the NWPP Procedures.

### C. Eligibility Criteria for Suppliers

1. The amount of capacity that the Supplier must deliver for Operating Reserves Services is the Spinning Reserve requirement and Supplemental Reserve requirement.
2. NOTE: The ability to self-supply from **Slice**<sup>2</sup> will not be available beginning October 1, 2011 due to changes in the Slice product.

---

<sup>1</sup>Open Access Same-Time Information System

<sup>2</sup>Slice Loss Return: The loss return type whereby calculated losses are deducted from a Power Services' Slice customer's share of federal generation at the bus 168 hours after service was provided.

3. The supply of Operating Reserves Services requires BPA Transmission Services' Dittmer Control Center (DCC) and Munro Control Center (MCC) to communicate with the Supplier's **Energy Management System (EMS)**<sup>1</sup> for deployment of reserves.
4. The Supplier's EMS must be staffed 24 hours a day, 7 days a week to assure dispatch contact is available.
5. The Supplier will pay all installation costs incurred by BPA Transmission Services for telemetry and monitoring. Costs will include labor, software for **AGC**<sup>2</sup>, communication, as well as upgrade of both the Customer and BPA Transmission Services facilities.
6. The Supplier will be responsible for the ongoing maintenance costs of its equipment.
7. The Supplier must have deliveries from resources in the BPA Control Area equal to or exceeding 150 annual aMW so that BPA Transmission Services is able to measure and verify the Supplier's response. This requirement assures that reserve deployment, which is based on the **Allocation Ratio**<sup>3</sup> of BPA's Control Area requirements, results in whole megawatt dispatch orders being sent to Suppliers when reserve energy is called upon. It is common for reserve energy requirements to be a fraction of the total reserve requirement. For instance, a 10% reserve energy requirement is deployed when a contingency of 10% of the total reserve requirement occurs.
  - a. When submitting a request to supply Operating Reserves Services the Supplier must provide a demonstration that it will have 150 aMW of deliveries. The demonstration may be based on long-term contracts, reasonably expected short-term use, or a combination of both.
  - b. To continue to supply Operating Reserves Services, the Supplier must have 150 aMW of deliveries during the FY. BPA Transmission Services will periodically check the Supplier's deliveries.
  - c. If the Supplier's use is not at least 150 aMW for the nine month period October 1 to June 30 in any FY during the two-year election period, it will not be allowed to supply for the remainder of the two-year election period.
8. The Supplier must comply with applicable WECC or NERC (or successor organizations) standards except where the WECC standards are in conflict with local regulatory requirements. The applicable WECC or NERC (or successor organizations) standards

---

<sup>1</sup>A control system (often computerized) designed to regulate the balance of generation and load in a control area by controlling the operation of generation, transmission, loads consistent with scheduled system frequency and voltages.

<sup>2</sup>Automated Generation Control

<sup>3</sup>The percentage of BPA Control Area Operating Reserve Requirement obligation assigned or allocated to a party that is providing resources to meet its Operating Reserve Requirement, rather than purchasing its Operating Reserve Requirement from Transmission Services.

include but are not limited to the following:

- a. WECC Standard BAL-002-WECC-2 - Contingency Reserves or its successor
  - b. NERC BAL-002-1 or its successor
9. BPA Transmission Services may require the Supplier to provide copies of its filings with WECC.
  10. The Supplier must have an executed operating agreement with BPA Transmission Services prior to becoming a Supplier.
  11. The Supplier who is providing reserves for a third party Customer must have a written agreement between BPA Transmission Services, the third party Customer, and itself.
  12. If a Supplier receives six strikes during a single FY in a Customer's two-year election period because of the Supplier's failure to provide BPA Transmission Services the amount of capacity or energy needed to meet the Supplier's Operating Reserve Requirement for any hour, the Supplier's ability to supply Operating Reserve Services will be suspended for the remainder of the two-year election period.
  13. The following examples constitutes a strike:
    - a. One strike: the Supplier failed to provide its capacity requirement to BPA Transmission Services for one hour in a given day, the Supplier failed to deliver and /or sustain the capacity requirement to BPA Transmission Services when a contingency response or test signal was requested, or the Supplier failed to comply with the performance standards.
    - b. Three strikes: the Supplier failed to provide its capacity requirement to BPA Transmission Services for three different hours in a given day.
  14. BPA Transmission Services will notify the Supplier of a strike by letter, email, or phone call.
  15. The Supplier will be notified in writing of the effective date of the suspension of its right to supply Operating Reserves Services.
  16. The Operating Reserve Requirement that a Supplier must provide is based on the sum of the Supplier's hourly transmission schedules from generators, or to load in BPA's Control Area, plus the hourly requirements service from BPA's generators, plus the on-line internal generation (behind the Customer's meter) in the BPA Control Area.
  17. Each Supplier of Operating Reserves shall carry its proportionate share of the Operating Reserve Requirement.
  18. The Supplier's Operating Reserve Requirement divided by the BPA Control Area's Operating Reserve Requirement, as defined by WECC and NERC, is the Supplier's Allocation Ratio.

19. Present BPA Transmission Services Operating Reserve Requirements are identified in the WECC standard BAL-002-WECC-2 or its successor. The current standard is “the hourly amount of contingency Reserve equal to the sum of three percent of hourly integrated Load plus three percent of hourly integrated generation.”
20. This Allocation Ratio is multiplied by the BPA Control Area's energy deployment for the contingency event to establish the Supplier's reserve energy delivery for each hour.
21. Resources in the BPA Control Area that are delivering firm power but do not have all the necessary Operating Reserve Requirement provided by BPA Transmission Services' Ancillary Services will supply Operating Reserves as Control Area Services.
22. If the Supplier providing the Operating Reserves Services is: 1) a member of the NWPP and 2) a participant in the Reserve Sharing Group (RSG), then settlement procedures for reserve deliveries required under the RSG agreement will follow that agreement.
23. If the Supplier is not a member of the RSG, then BPA Transmission Services will administer the Supplier's contribution and its obligation to Reserve Sharing as billing credits or debits.
24. Supply of Operating Reserves Services outside of BPA's one Control Area concept as described in 16-19 above requires the Supplier to request an exemption from BPA Transmission Services.
25. To independently supply Operating Reserves Services for only the Supplier's contingency events, the Supplier must provide reserves for the full amount of its prospective resource loss and meet the requirements listed below. In all cases, no residual obligation shall be placed on the BPA Control Area.
  - a. Submit a written request to the Transmission Account Executive expressing its desire to independently supply Operating Reserves Services
  - b. Provide physical evidence, which may include metering, that demonstrates total independence from BPA Transmission Services support
  - c. Install equipment necessary for BPA Transmission Services to determine if the estimated schedules for resources and deliveries to loads stayed within the net schedules submitted to BPA Transmission Services
26. BPA Transmission Services will provide a written response to the Customer no later than 60 days after receipt of a written request to independently supply Operating Reserves Services.
27. The following are examples of when the Supplier may request an exemption be made to supply Operating Reserves Services outside the one Control Area concept:
  - a. A Supplier that trips load greater than or equal to the resource loss; or
  - b. The load and resource are part of an integrated process where load and generation directly track each other.

- c. Interruptible Exports such that the receiving system provides Operating Reserves Services for 100% of the transmission schedule. Prior to implementation, BPA Transmission Services must approve fully automated systems and detailed design considerations.
28. The Operating Reserve Requirement must be available at all times; fully delivered within 10-minutes after BPA Transmission Services sends a signal for Operating Reserves; and sustained for the remainder of the Scheduling Hour unless otherwise requested by BPA Transmission Services.
  29. BPA Transmission Services will perform unannounced capability tests to assure that capacity is fully available within 10-minutes.
    - a. BPA Transmission Services will work with the Supplier, when necessary, to establish acceptable time frames when the Supplier's system cannot accept energy.
    - b. The capacity test(s) will net to zero integrated MWs within the current minimum schedule granularity unless a real time disturbance occurs which will require the integrated MW to be zeroed out in the next hour. This includes a signal to the Supplier's system.
  30. If the Supplier fails the capability test, a strike is assessed.
  31. If the strike is due to the Supplier not carrying the full amount of its Operating Reserve Requirement, BPA Transmission Services will pass on to the Supplier, and the Supplier or Customer shall be obligated to pay any penalties BPA Transmission Services may incur due to violation of WECC or NERC standards.
  32. If the strike is due to the Supplier's failure to fully meet its **Operating Reserve Deployment**<sup>1</sup> requirement, BPA Transmission Services will pass on to the Supplier, and the Supplier or Customer shall be obligated to comply with, any penalties imposed under NERC Distribution Control Standards.
  33. The Supplier shall be required to demonstrate that it has adequate, firm, transmission available to deliver the reserves to BPA Transmission Services across posted Network Flowgates or External Interconnections. If the Supplier does not have firm transmission available to deliver its reserves obligation, it will be assessed a strike for each hour it can not do so.

---

<sup>1</sup>The sending of generation request signals to resources providing contingency Operating Reserves.

34. If transmission is not available, the Supplier must arrange an alternative delivery to BPA Transmission Services. These alternatives include the following:
  - a. Carrying reserves on resources not affected by the posted constrained path
  - b. Using transmission capability from the Supplier's existing rights
  - c. Acquiring transmission rights
35. The BPA Transmission Services **ATC**<sup>1</sup> Methodology can be found on BPA Transmission Services' public web site at [http://www.transmission.bpa.gov/business/atc\\_methodology/](http://www.transmission.bpa.gov/business/atc_methodology/)
36. A Customer who elects to obtain Operating Reserves Services from a Supplier other than BPA Transmission Services and is acquiring full or partial requirements service (Net Load Forecast) from BPA Power Services, must submit either a transmission schedule or its Net Load Forecast to BPA Transmission Services in accordance with BPA Transmission Services' scheduling windows. The Customer is responsible for submitting a transmission schedule or a Net Load Forecast pursuant to the following:
  - a. BPA Transmission Services may assess the accuracy of the Customer's transmission schedules or the Net Load Forecasts using the Industry Accepted Statistical Process Control Standards<sup>1</sup>, which are the combined results of time series and moving range charts, to determine when transmission schedules or the Net Load Forecast have exceptional variation. See Attachment A below for examples.
  - b. Exceptional variation occurs when the forecast error exceeds one of the following:
    - i. Daily Upper Range Limit
    - ii. Daily Upper Natural Process Limit
    - iii. Daily Lower Natural Process Limit
  - c. A predictable process exhibits routine variation.
  - d. An unpredictable process exhibits both routine variation and exceptional variation. It is BPA Transmission Services' intent to discourage exceptional variation.
  - e. The difference between the actual load minus the transmission schedules or the Net Load Forecast is the load forecast error, which will provide evidence of the underlying behavior. BPA Transmission Services' expectation is that the transmission schedules or the Net Load Forecast error is zero on a daily basis.
  - f. If a Customer or its scheduling agent, fails to submit accurate transmission schedules or a Net Load Forecast that results in cost shifts to BPA Transmission Services, BPA

---

<sup>1</sup>Available Transfer Capability

Transmission Services shall have the costs passed on to the Customers.

- g. Failure to meet the accuracy standards described in this section will result in a strike. Also see 11 above.

<sup>1</sup>Wheeler, Donald, Chambers, David S., "Understanding Statistical Process Control," Second Edition, SPC Press and Wheeler, Donald J., "Understanding Variation - The Key to Managing Chaos," second edition, SPC Press

#### D. Communication to BPA Control Centers

1. Deployment of the Supplier's resources must be accomplished using automated response to electronic signals from BPA Transmission Services.
  - a. The resource(s) may be system rather than individual resources.
  - b. System resources require independent response verification information.
2. The Supplier shall exchange real-time data with BPA Transmission Services using the ICCP data link between BPA's two control centers, DCC and MCC, and the Supplier's EMS (or resource).
3. The Supplier shall exchange other types of data, such as schedules, generation estimates, meter readings, etc., with BPA Transmission Services using the WECC Electronic Industrial Data Exchange (EIDE) protocol or **Customer Data Entry (CDE)**<sup>1</sup>.
4. Real-time data exchange shall conform to WECC standards for inter-utility data exchange, including availability, bandwidth, security, and reliability.
5. Real-time data exchange and control signals must have a periodicity of 10 seconds or less.
6. The Supplier shall provide the following data to BPA Transmission Services for its resources internal to the BPA Control Area:
  - a. Instantaneous net hydro generation. This information determines the hydro portion for establishing deployment of Operating Reserves.
  - b. Instantaneous non-hydro generation. This information determines the thermal portion for establishing deployment of Operating Reserves.
  - c. Generation Estimates of scheduled generation for each Supplier's resource (or system) for the current hour and the next hour, plus the instantaneous Generation Estimates for the Supplier's resource (or system).

---

<sup>1</sup>A Transmission Services access point that allows a customer to obtain information pertaining to its Ancillary Services, Loss Return obligations, portfolio manager, and contract portfolio manager.

- d. The maximum, minimum, and spinning generating capability available within the NERC defined Disturbance Recovery Time Period refreshed (updated) every five minutes. Operating Reserves shall be held available at all times until a contingency occurs.
  - e. The Participation Factors of each resource that the Supplier wishes to have deployed when reserves are called upon in order to distribute the response to multiple resources. The total of all Participation Factors equals 100% (1.00 per unit from definition). BPA Transmission Services must know where reserve supplies are coming from. A zero **Participation Factor**<sup>1</sup> means the resource is not available for operating reserves deployment.
  - f. The actual instantaneous generation, in MW, of each resource that is providing reserves.
  - g. Status of the Supplier's EMS. (An EMS that is out of service usually means the supply cannot be provided so BPA Transmission Services will automatically default to BPAP for additional Operating Reserves.)
7. A Supplier providing system responses shall provide the following data to BPA Transmission Services:
- a. **Dynamic Schedule**<sup>2</sup> of its response to the BPA Transmission Services Operating reserve deployment
  - b. Net interchange deviation
  - c. System error signal, (for control areas, this is the Area Control Error (ACE))
  - d. The status of the Supplier's EMS

## E. Communication to the Supplier

1. BPA Transmission Services will determine the Supplier's Operating Reserve Requirement for the current hour and an estimate for the next hour.

---

<sup>1</sup>The per unit (= % / 100) amount of the resource provider's delivery designated by plant. For example, when the control area calls upon a reserves provider to deliver 10MW, the provider may designate participation factors of 0.3; 0.2; and 0.5 (sum=1) for its units A, B, and C respectively. The response to the control area request would then be, by unit: A=3MW; B=2MW; C=5MW.

<sup>2</sup>A telemetered reading or value that is updated in real time and used as a schedule in the Automatic Generation Control (AGC) and the Area Control Error (ACE) equation and the integrated value of which is treated as a schedule for interchange accounting.

2. The Operating Reserve Requirement will be used to calculate the Supplier's Allocation Ratio and will change as transmission schedules are changed or generation amounts vary (may vary within the hour).
3. In the event of a contingency, the megawatt amount of reserve energy the Supplier must deliver will be sent from BPA Transmission Services over a data link to the Supplier's resources or through the Supplier's control center. If the resource is outside of the BPA Control Area the megawatt amount of reserve energy that the Supplier must deliver will be sent from BPA Transmission Services to the Supplier's control center.
4. BPA Transmission Services will send a signal to the Supplier representing the Plant Request or **Setpoint**<sup>1</sup> up for the remainder of the Scheduling Hour (or 65 minutes for a NWPP Reserve Sharing event) to deliver Operating Reserves Services by the Supplier as follows:
  - a. Plant Request or Setpoint = **Basepoint**<sup>2</sup> + (Transmission Services deployment requirement (or MW loss)) \* (Transmission Services normalized Participation Factor)\* (Operating Reserves Allocation Ratio); or
  - b. A Dynamic Schedule for the Supplier's system resources. Dynamic Schedule = (Transmission Services deployment requirement (MW loss))\*(Operating Reserves Allocation Ratio).
  - c. A verification status flag confirming that the new Setpoint represents a valid operating reserve delivery request. The Setpoint is limited to the Basepoint plus the Supplier's requirement.
5. During non-contingency conditions, BPA Transmission Services will send to the Supplier a Setpoint request signal with the BPA Transmission Services deployment requirement equal to zero except when testing.
6. The Supplier Recovery Error must reach zero or positive MW prior to 10-minutes after receiving the Plant Request or Dynamic Schedule and continuing through the end of the Contingency Reserve Restoration Period.

---

<sup>1</sup>A request to a generating resource for operation at a particular power level; or a control signal sent to a generating resource requesting a setting of the Basepoint at a particular megawatt level.

<sup>2</sup>A generator estimate which is normally held constant during the hour except during the ramp period from ten minutes before the hour to ten minutes after the hour, when plant-operating schedules for the next hour are changed to match the plant transmission schedules. Plants used for provision of Ancillary or Control Area Services will receive more frequent adjustment to their Basepoint, in response to BPAT control signals.

- a. The Supplier Recovery Error equals Actual Generation in MW, minus the Setpoint in MW, measured over the Disturbance Recovery Time Period.
  - b. The Supplier Recovery Error, in MW, will be recorded accurate to 1/10 MW. If the performance does not reach 100% Plant Compliance factor, then it will be counted as strike.
    - i. For  $0 < t < 10$  min.
    - ii. Plant Compliance Factor (i) =  $[\text{MW loss} - \max\{0, \text{precontingency Supplier Recovery Error (i)} - \text{maximum Supplier Recovery Error (i)}\} / \text{MW loss}] * 100\%$ .
    - iii. Where (i) represents each resource beginning with the first resource continuing through n resources.
    - iv. Where (n) is the total number of resources the Supplier is using.
7. For circumstances where system resources are used, the ACE and Net **Interchange**<sup>1</sup> Deviation will be used as the Supplier Recovery Error.
  8. BPA Transmission Services will notify each Supplier of the MWh of reserve energy, and any additional information that both parties agree to, it delivered for each hour of contingency either through the EIDE or the **CDE**<sup>2</sup>.
    - a. The notification will occur shortly after the conclusion of the hour of the contingency.
    - b. BPA Transmission Services will coordinate the energy settlement for reserve energy deliveries among appropriate Suppliers.

## F. Appendix A: Process Behavior Chart


Note: A strike will be assessed if the Transmission Customer's actual load minus scheduled load or net load forecast error exceeds the upper or lower limits.

---


<sup>1</sup>Energy transfers that cross Balancing Authority boundaries.

<sup>2</sup>Customer Data Entry



Sample NT Customer Moving Range Chart  
June 2003

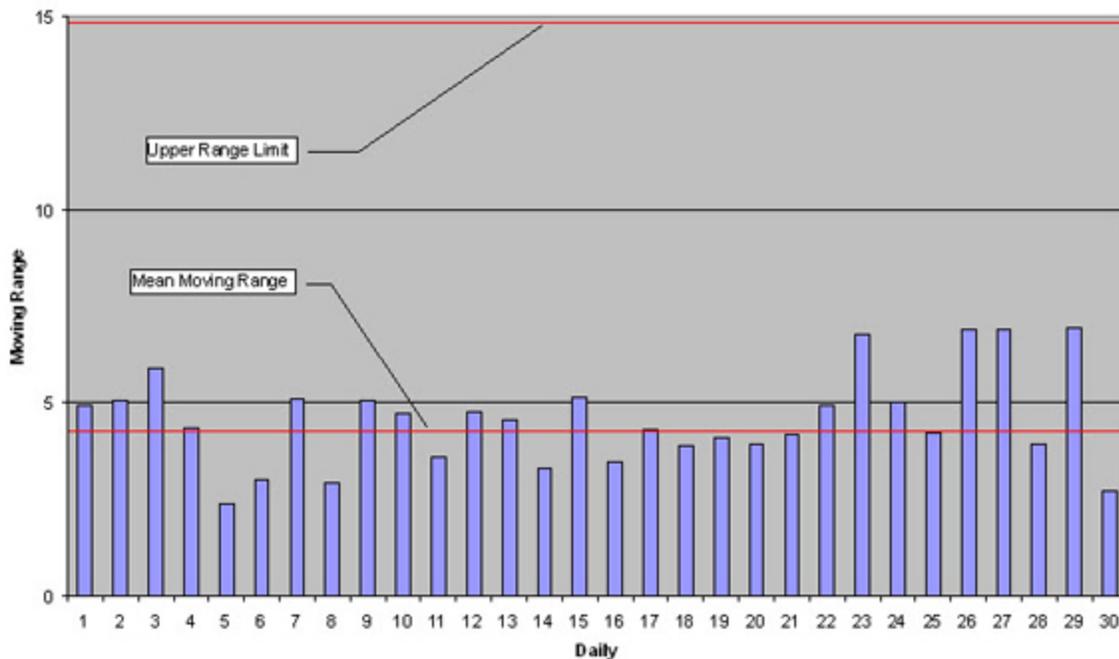

Sample NT Customer Load Forecast Error  
June 2003

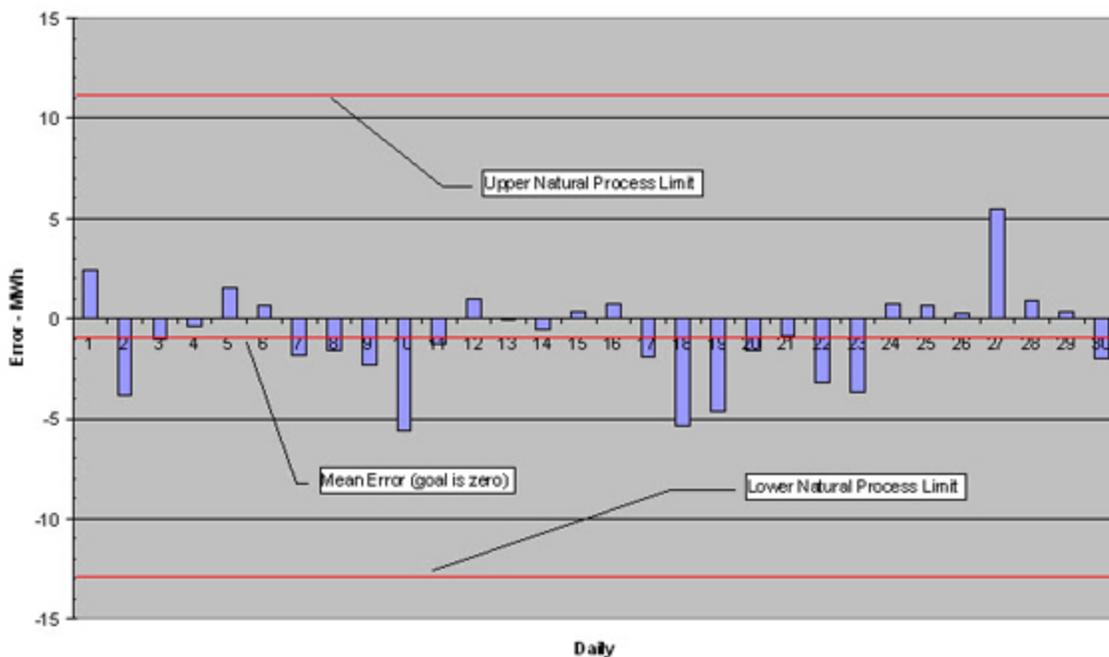

G. Appendix B: Operating Reserves - Determination of MW Loss

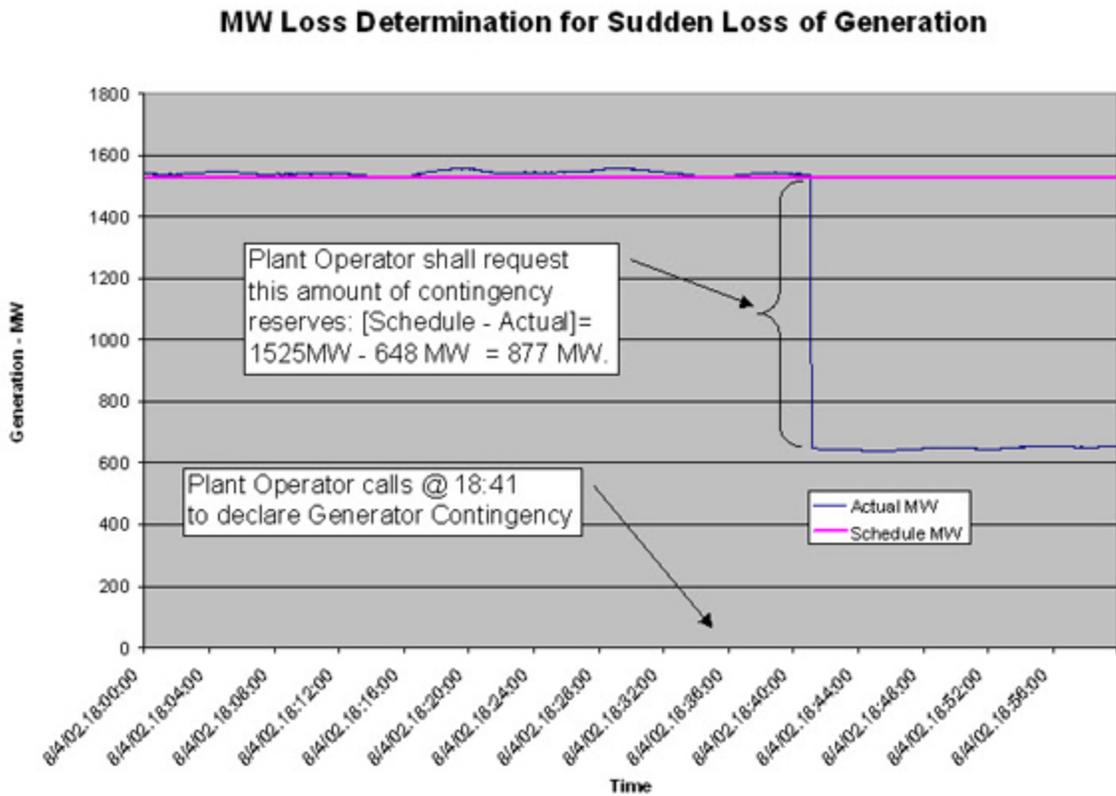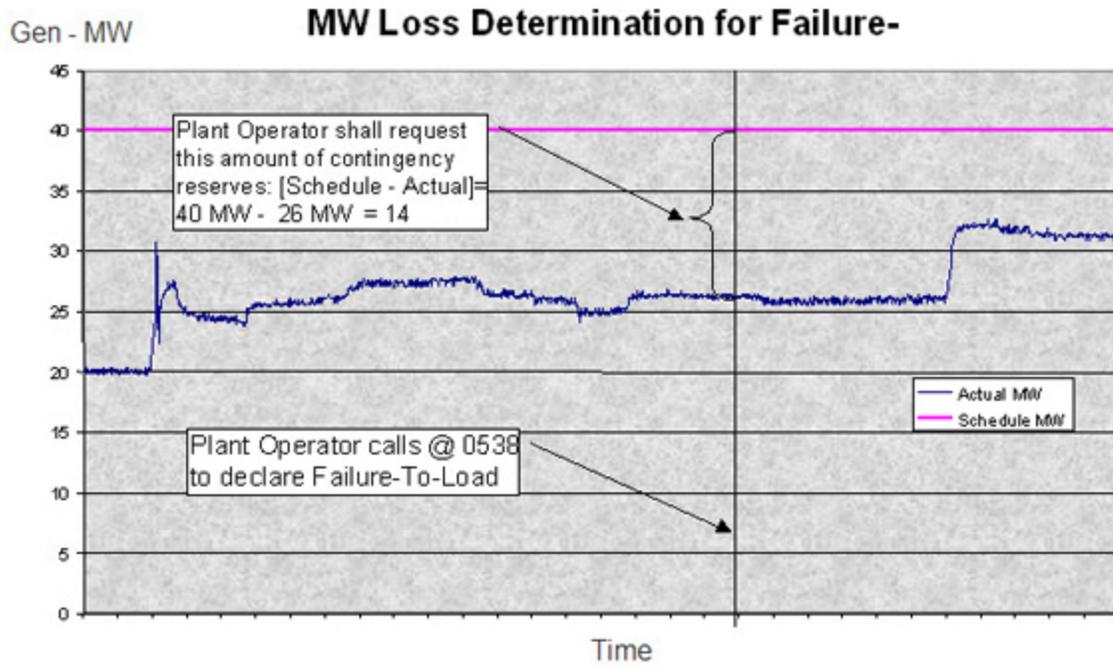

## H. Energy Indices

The energy index for energy settlement for Operating Reserves for both Spinning and Supplemental Reserves is the PowerDex Mid-Columbia Hourly Energy Index. For NWPP Reserve Sharing transactions the energy index described in the NWPP procedures will be used.

## I. Additional Information

### Policy Reference

- [OATT](#): Sections 3, Schedule 5, Schedule 6

### Related Business Practices

- Energy Imbalance
- Generation Imbalance
- [On Demand Resource](#)<sup>1</sup> Scheduling
- Requesting Transmission Service
- Scheduling Transmission Service
- Customer Data Entry

### Version History

Version 10	6/9/14 Version 10 incorporates the changes required to be consistent with the FERC approved WECC standard BAL-002-WECC-2.
Version 9	08/22/13 Version 9 incorporates the energy index notice posted on OASIS on August 22, 2013. This notice changes the energy index used for the settlement of Operating Reserves from the Dow-Jones Mid-Columbia Firm Power Index to the Powerdex Mid-Columbia Hourly Energy Index in Section H.
Version 8	04/12/13 Version 8 includes updates to the applicable rate period in section B. The updates reflect generic rate period language rather than specific dates for the current rate period. The changes to Version 8, Section B, include: <ul style="list-style-type: none"> <li>• Step B.3.c: Replaced dates with "at the start of the next rate Period" and "May 1 prior to the start of the next Rate Period, and stating whether the customer intends to:"</li> <li>• Step B.3.c.ii: Replaced date with "at the beginning of the subsequent Rate Period."</li> <li>• Step B.3.c.iii: Replaced date with "May 1 prior to the start of the year during the Rate Period"</li> </ul>

---

<sup>1</sup>a. A resource located within BPA's Balancing Authority Area; b. An arrangement with a neighboring Balancing Authority that allows the delivery of power on BPA's system to or from a neighboring system; or c. A Demand Response Resource capable of meeting the technical requirements for an On Demand Resource.

	<ul style="list-style-type: none"> <li>• Step B.3.c.iv: Replaced date with "July 1 prior to the start of the next Rate Period".</li> </ul>
Version 7	06/28/12, Version 7 incorporates the Energy Index Bulletin, Version 3 into the new section H as Energy Indices. The incorporation moves all associated information from the Bulletin into one document.
Version 6	02/14/11 Added step 2 note under Eligibility Criteria for Suppliers.
Version 5	09/20/10 Changes from version 4 to version 5 are: Section 3 • Step 3.1: Added "Note that Operating Reserves are referred to as contingency reserve in WECC and NERC documents." • Step 3.3: Deleted "Minimum Operating Reliability Criteria (MORC)" and added "standard for contingency reserves". Section 4 • Step 4.3.3 - 4.3.3.4: -Changed the dates to reflect the current two-year election period beginning October 1, 2011 through September 30, 2012. • Step 4.6.4: Deleted step Station service will not be included as energy delivered when a contingency is declared. Section 5 • Step 5.7: Replaced "policies" with "standards" • Step 5.7.1: Updated WECC and NERC standards list. • Step 5.32: Replaced "constrained paths" with "Network Flowgates or External Interconnections". • Step 5.34: Replaced "Constrained Paths" with "ATC". Section 6 • Step 6.3: Replaced "Web Interface (CWI)" with "Date Entry (CDE)" Section 7 • Step 7.8: Replaced "CWI" with "CDE" Section 8 • Step 8.1: Added Customer Data Entry Implementation business practice and Energy Index bulletin to list.
Version 4	04/16/09 This version includes current dates in section 4.
Version 3	07/26/06 Section 4, steps 4.3.3, 4.3.3.1, 4.3.4, and 4.3.4.1 reflect changes incorporating the time period for which a Customer must commit to self-or third party supply Operating Reserves.
Version 2	9/22/03 (1) revised section B.1 to enable BPAT to make continual reviews of the Transmission Customer's ability to supply reserves based on changing conditions to BPAT's system or Transmission Customer's ability to meet the criteria; (2) revised section B.3.e thru g to change the party responsible for contingency energy per the 2004 rate case; (3) revised section C.5 to incorporate additional criteria enabling BPAT to review the 150 MW floor criteria throughout the FY; (4) revised section C.9(3) to incorporate additional scenario for when a strike would apply; (5) revised C.10 to clarify the "one Control Area" concept; (6) added subsections 15 thru 21 to section C to address requirement of the availability of Operating Reserves when called on (subsection 15), the right to test Supplier's response to a BPAT signal at any time (subsection 16), additional penalties (subsections 17 - 18), availability of transmission to deliver reserves (subsection 19), additional criteria for

	<p>Transmission Customers who request to acquire third party reserves from a Supplier other than BPAT (subsection 20), and BPAT’s right to assess the accuracy of the Transmission Customer’s transmission schedules or Net Load Forecasts and apply strikes (subsection 21); (7) replaced Appendix A “Example” with “Process Behavior Charts”; (8) replaced Transmission Customers, Third Party Provider, Provider, and Self-Supply in sections C thru H with Supplier where applicable; (9) replaced Basepoints with Generation Estimates, and Supplier Control Error with Supplier Recovery Error; (10) added 2 definitions for Generation Estimates and Supplier; and (11) deleted Sections F, G, and H because of redundancy.</p>
<p>Version 1</p>	<p>5/14/03 This revision is to add clarification to (1) section C.9 regarding the interpretation of the performance standards applicable to self-suppliers of Operating Reserves (2) Section C.14.c. regarding self-supplying outside the one control area concept, (3) Section B.4 regarding settlement under the Northwest Power Pool Reserve Sharing Procedures. Changes were also made in Section C.5. increasing the minimum criteria on deliveries from resources in the BPAT Control Area from 100 annual aMW to 150 annual aMW. Minor changes were also made such as incorporating redundant paragraphs into one paragraph.</p>